


**Note:**

Meter spreader to be provided and installed by the owner/plumber to establish the proper meter setting and meter spread. Spreader shall be removed by the Water Division when the meter is installed.

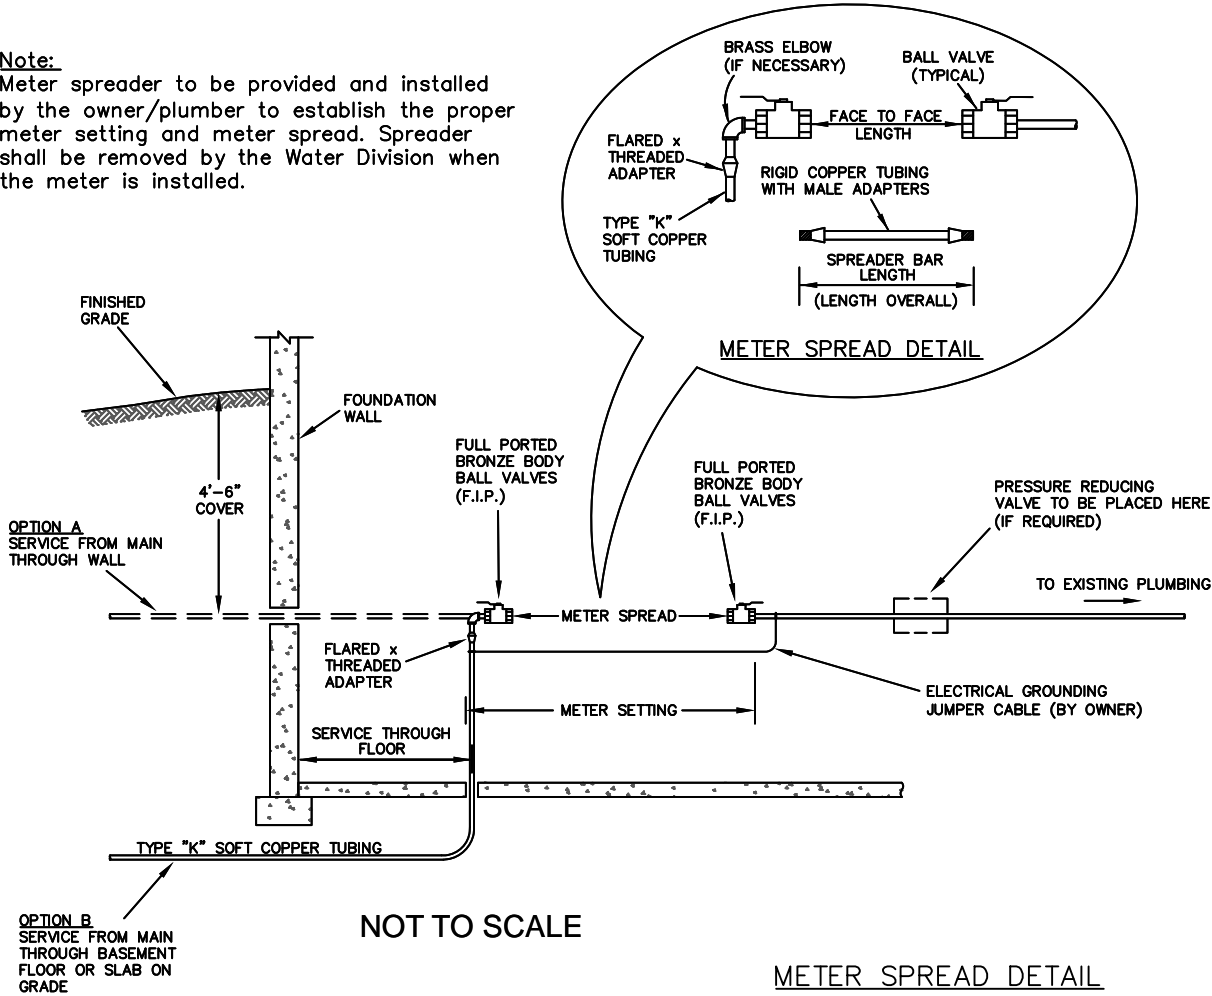

METER STYLE	METER SIZE	METER SPREADER PIPE SIZE	SPREADER BAR LENGTH	FACE-TO-FACE LENGTH
POSITIVE DISPLACEMENT	5/8" x 3/4"	3/4"	12-3/4"	11-5/8"
	3/4" x 3/4"	3/4"	14-1/4"	13-1/8"
	1"	1"	16-1/4"	14-7/8"
	1-1/2"	1-1/2"	OVAL FLANGE	13-1/4"
	2"	2"		17-1/4"
TURBINE	1-1/2"	1-1/2"	OVAL FLANGE	10-1/4"
TURBINE	2"	2"		10-1/4"

**Notes:**

1. No compression fittings are allowed before or within the meter setting.
2. No by-pass line is allowed.
3. All meters shall be installed horizontally (no exceptions permitted).
4. In no case shall connections be permitted on the service pipe upstream of the meter.
5. For service pipes two inch and smaller all fittings and valves on the service pipe and within the meter setting shall be red brass or bronze with flared or threaded connections only. All fittings shall have no lead content.


**City of Meriden**  
**Department of Public Utilities**  
**Water Division**

---

**RECONNECTION**  
**METER SETTING FOR 5/8" THROUGH 2"**  
**POSITIVE DISPLACEMENT AND**  
**TURBINE METERS**

**Note:**

Meter spreader to be provided and installed by the owner/plumber to establish the proper meter setting and meter spread. Spreader shall be removed by the Water Division when the meter is installed.

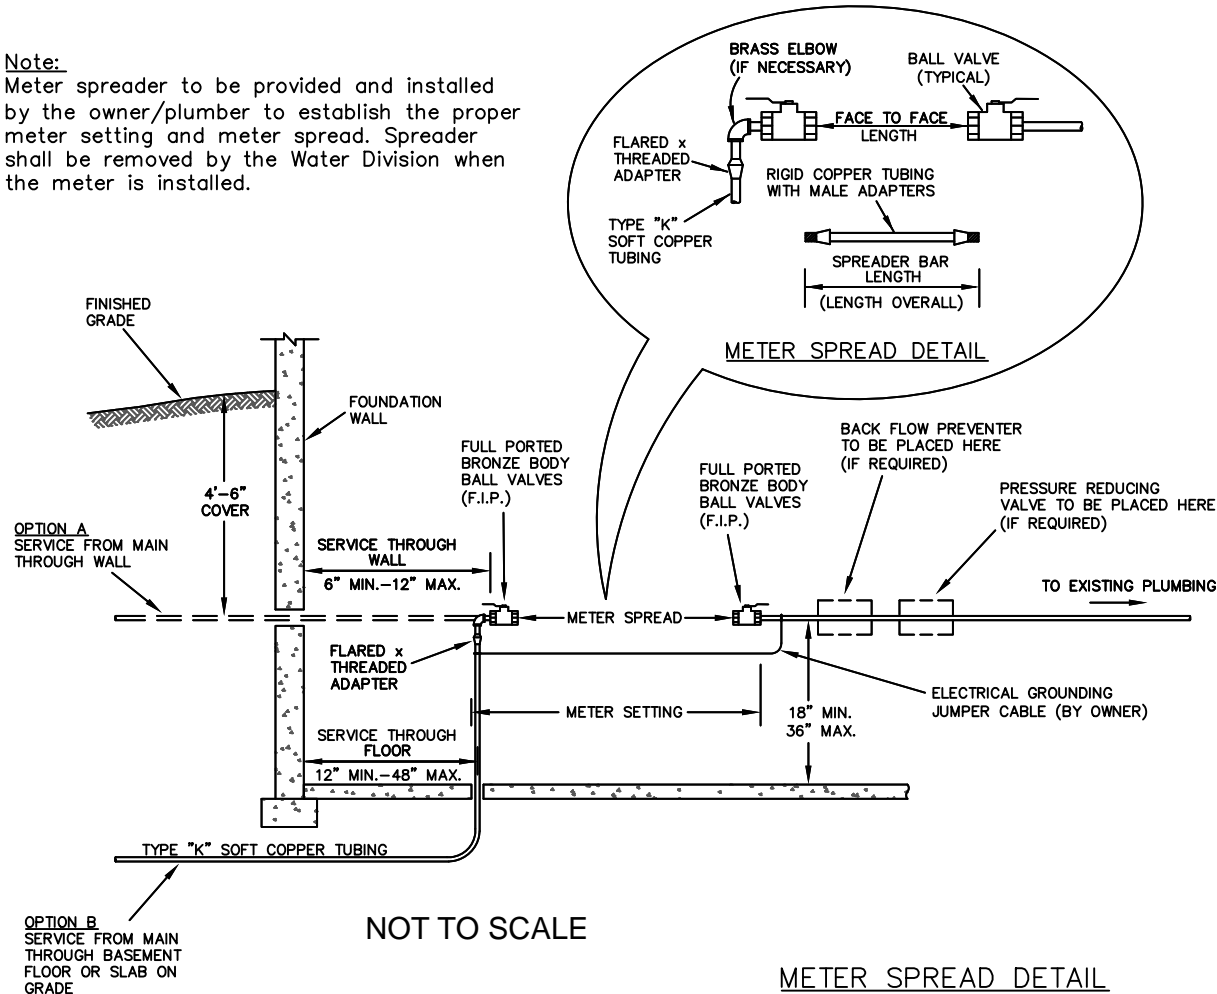

NOT TO SCALE

METER SPREAD DETAIL

METER STYLE	METER SIZE	METER SPREADER PIPE SIZE	SPREADER BAR LENGTH	FACE-TO-FACE LENGTH
POSITIVE DISPLACEMENT	5/8" x 3/4"	3/4"	12-3/4"	11-5/8"
	3/4" x 3/4"	3/4"	14-1/4"	13-1/8"
	1"	1"	16-1/4"	14-7/8"
	1-1/2"	1-1/2"	OVAL FLANGE	13-1/4"
	2"	2"		17-1/4"
TURBINE	1-1/2"	1-1/2"	OVAL FLANGE	10-1/4"
TURBINE	2"	2"		10-1/4"

**Notes:**

1. No compression or solder fittings are allowed before or within the meter setting.
2. No by-pass line is allowed.
3. All meters shall be installed horizontally (no exceptions permitted).
4. In no case shall connections be permitted on the service pipe upstream of the meter.
5. For service pipes two inch and smaller all fittings and valves on the service pipe and within the meter setting shall be red brass or bronze with flared or threaded connections only. All fittings shall have no lead content.

**City of Meriden**  
**Department of Public Utilities**  
**Water Division**

---

**NEW**  
**METER SETTING FOR 5/8" THROUGH 2"**  
**POSITIVE DISPLACEMENT AND**  
**TURBINE METERS**